

Natural Refrigerant Training Summit

Building a Sustainable Workforce

Hussmann CO2 Evacuation, Charging and Start-Up

John Bento

Hussmann



NORTH AMERICAN
Sustainable
Refrigeration
Council

Hussmann CO₂ Transcritical Rack

- Basics, operation, install, maintenance

HUSSMANN®

11/8/2023



Source Material

1. *Installation and Operation Manual*

- P/N 3182569
- April 2023

2. *TC CO₂ Sequence of Operation*

- Booster Refrigeration System

3. *Hussmann Transcritical Training Manual*

- April 2018, Revision 1



About Me



- 25+ years in Education
- 15 years teaching adult learners
- 5 years HVACR experience (US Navy)




Learning Objectives

1. Transcritical Operation
2. Components
3. Start-Up
4. Maintenance and Service




Transcritical Systems

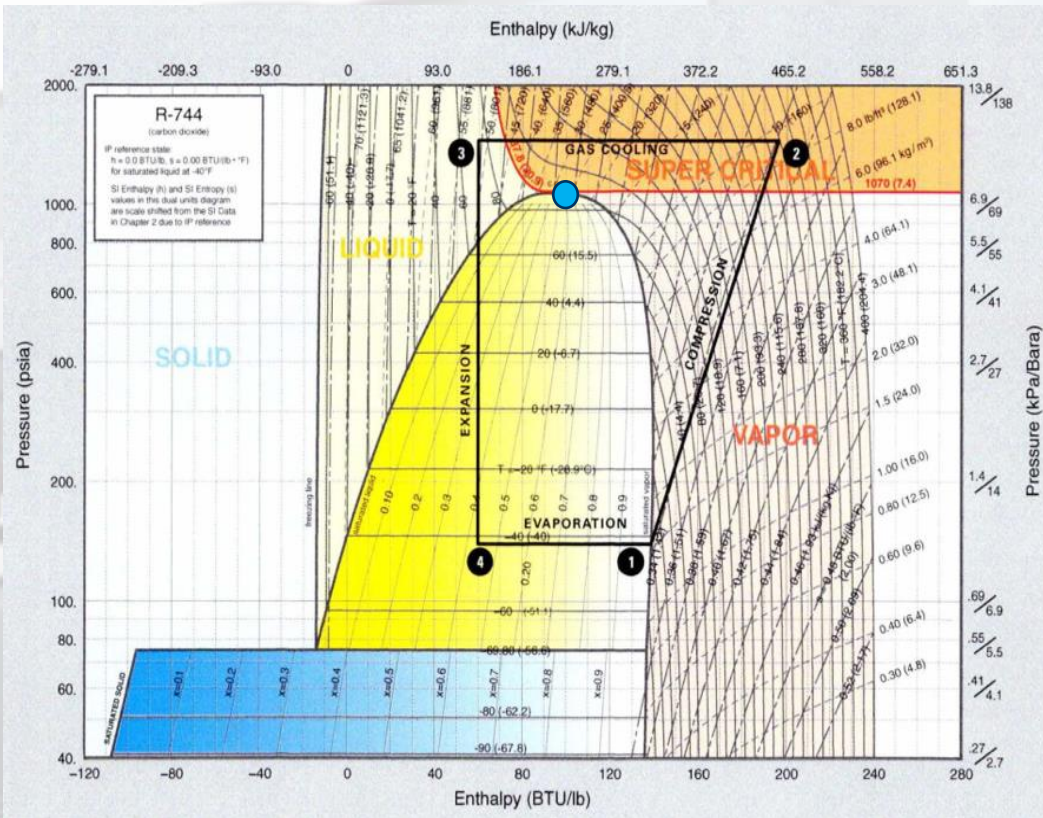


- Synthetic Refrigerants tend to have very high critical points
- R-22 = 70.1 C (158 F)
- R-410A = 73 C (163 F)
- R-513A = 96.5 C (205 F)
- **R-744 = 31 C !!! (87.8 F)**
- This means that CO₂ will operate in transcritical mode when the gas cooler outlet temperature is above 31 C (think Cancun, Monterrey, etc.)
- This could cause some customers to worry about an “energy penalty”

Transcritical Systems

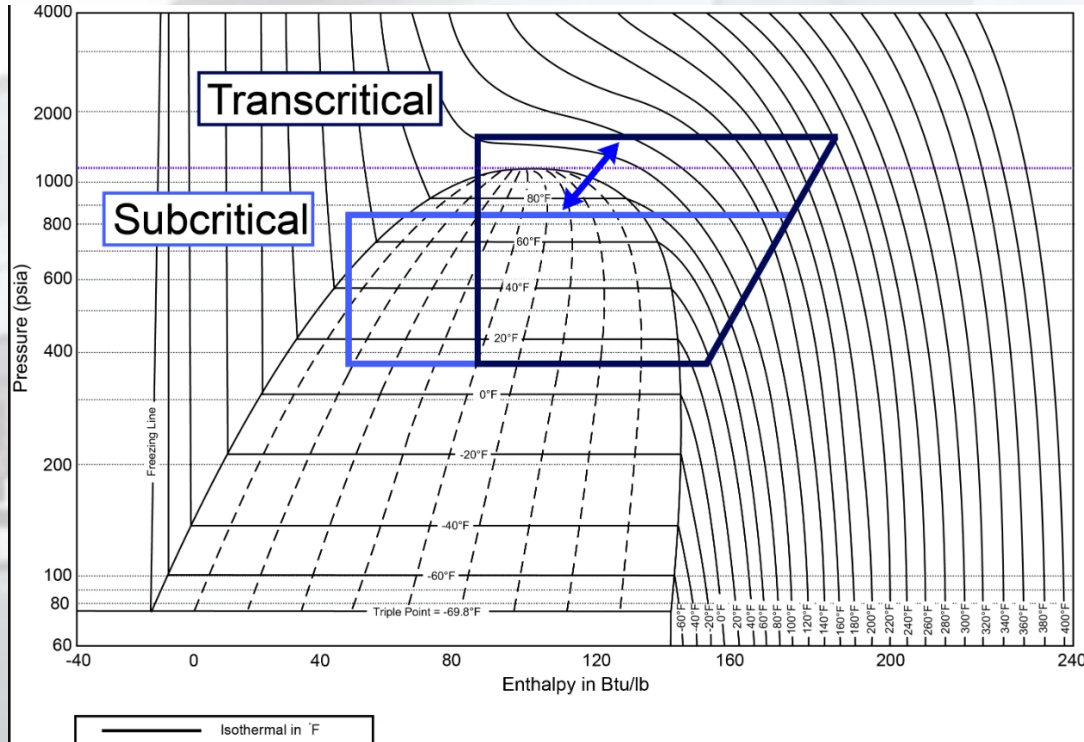

- In Sub-Critical operation, the condenser does just that, condenses the refrigerant by simply removing heat.
- In Trans-Critical operation (ambient temperature above 31C (87.8 F) The CO₂ can't condense just by the removal of heat, so the gas is cooled only.

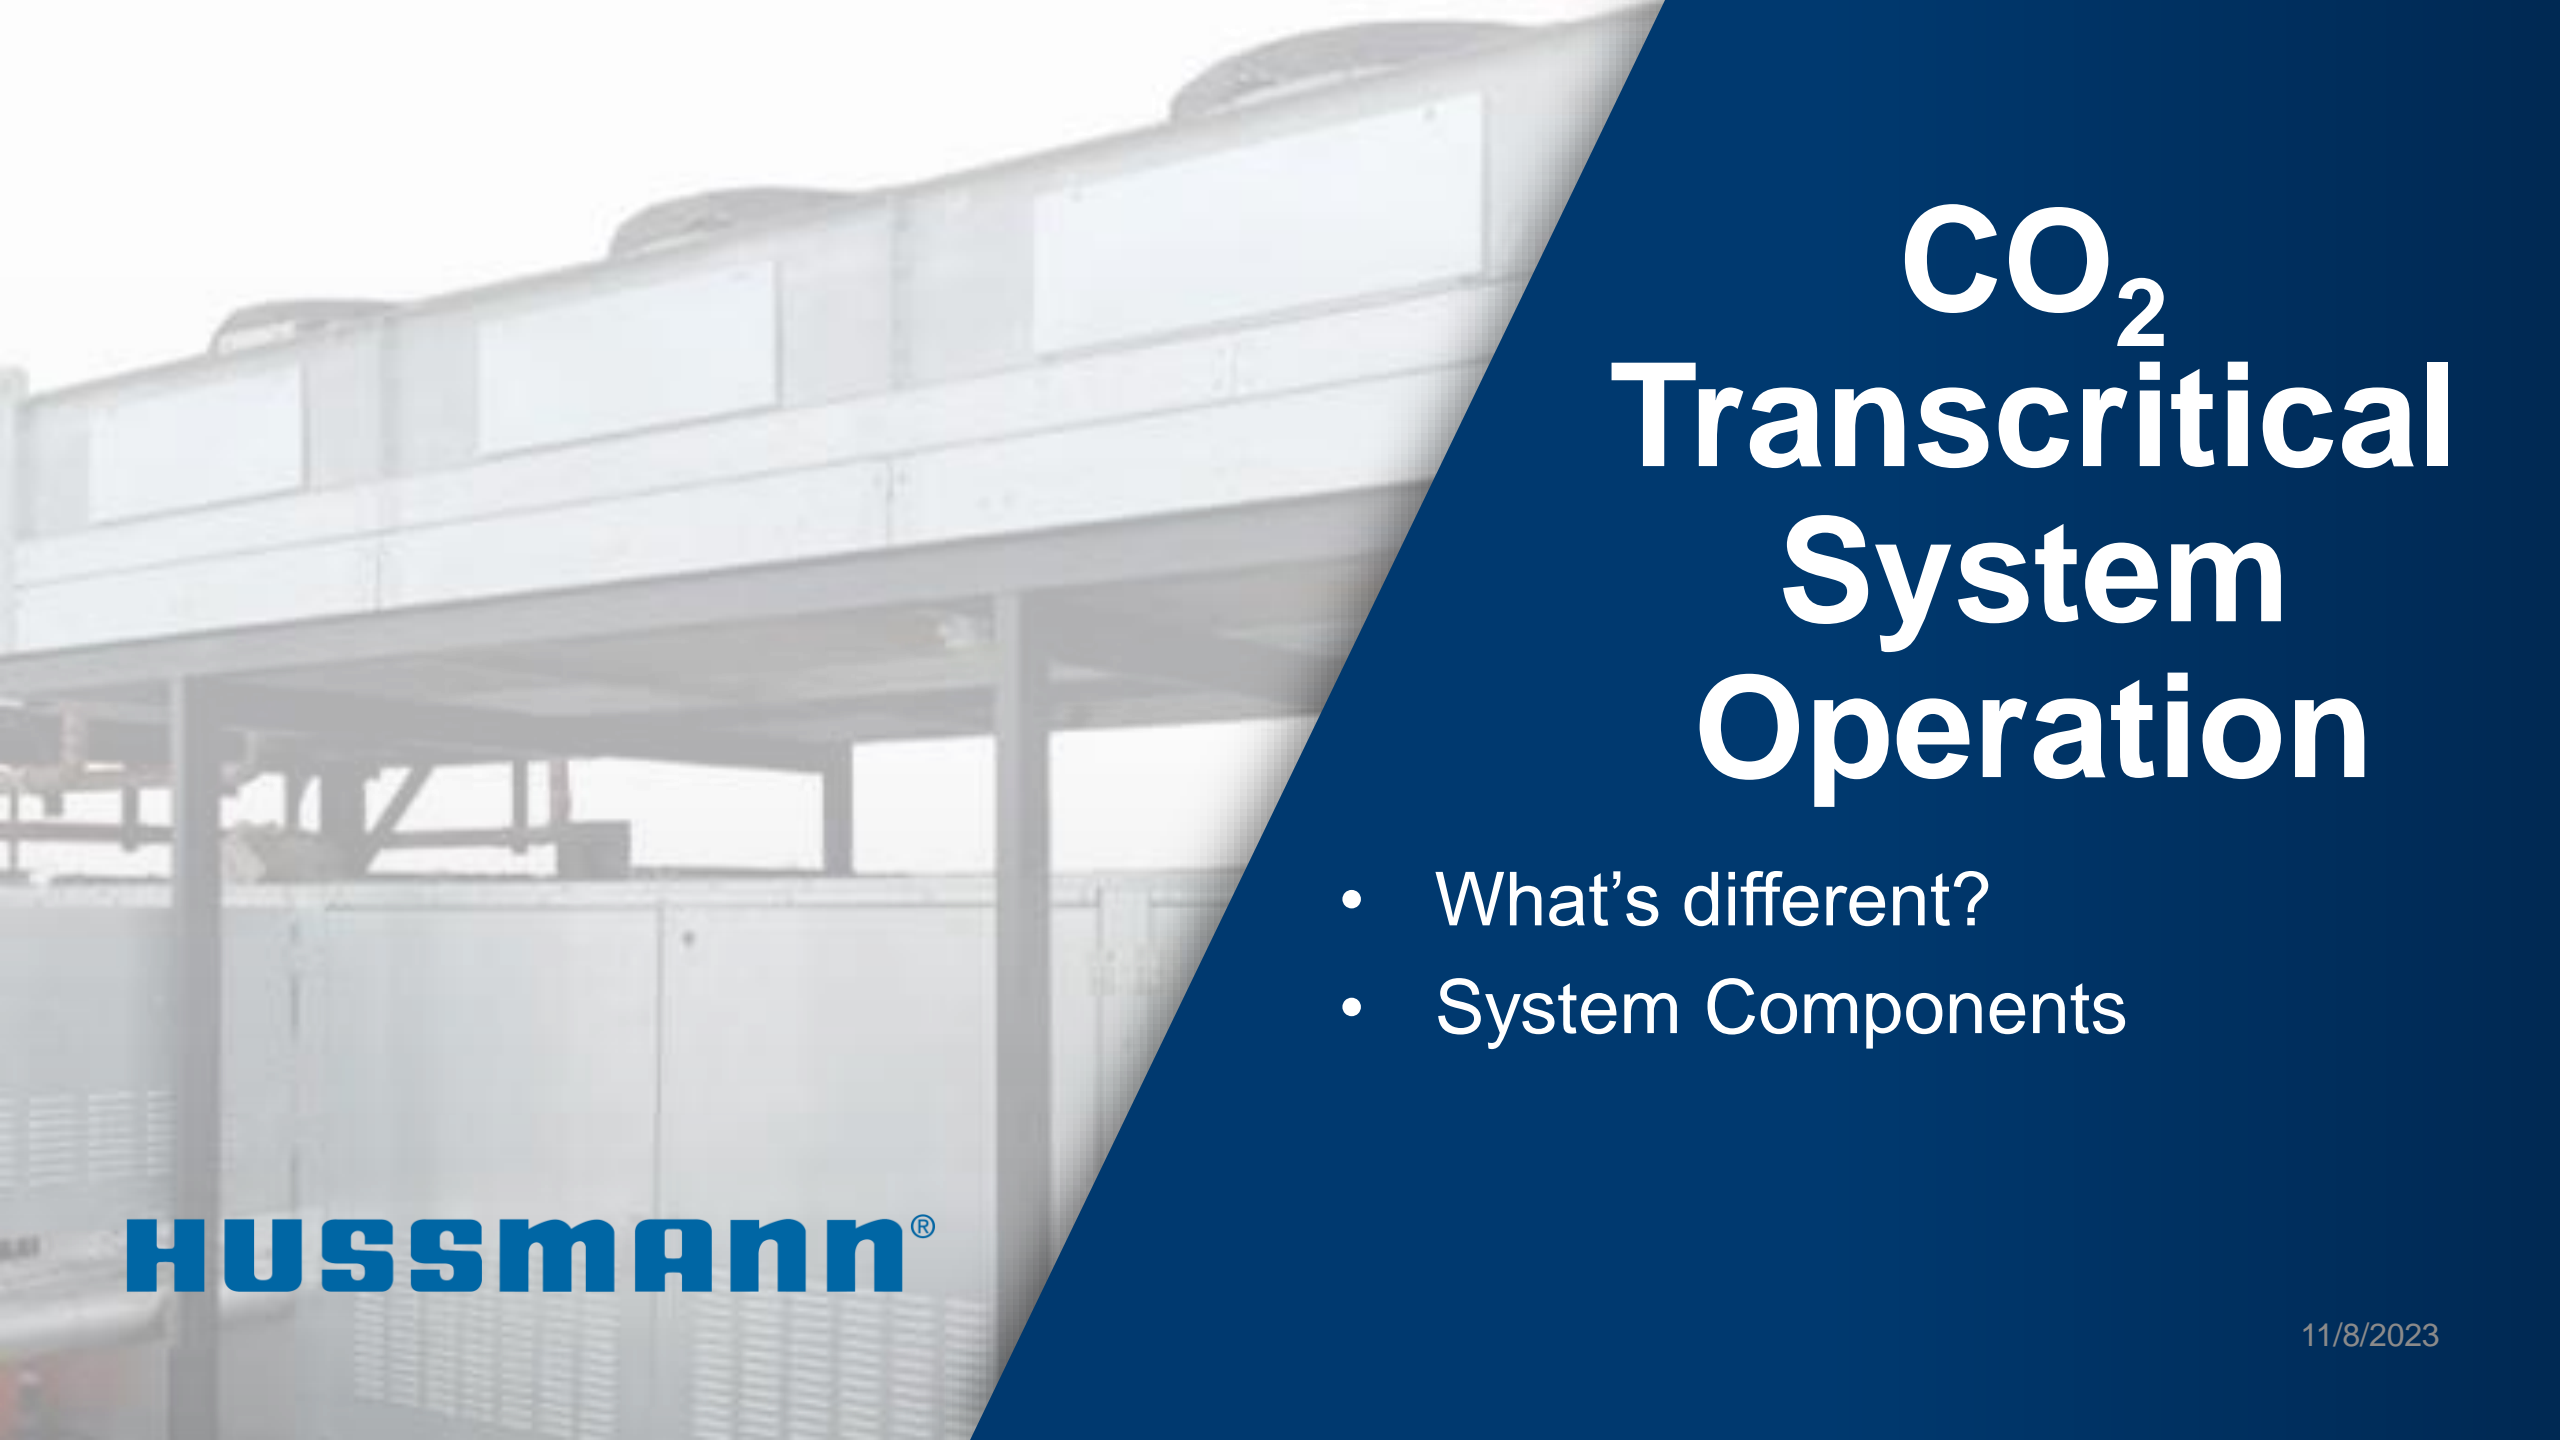

CO₂ Transcritical System Operation


- What's different?
- System Components

HUSSMANN[®]

System Layout and Operation


Starting at the discharge from the throttling valve (HPV) (basically a souped-up hold-back valve).....

- Drops pressure to force a state change
- Pending on gas cooler outlet temp and pressure, fluid will be a liquid/vapor mixture
- After leaving the HPV, CO₂ enters the flash tank where it separates due to different densities.

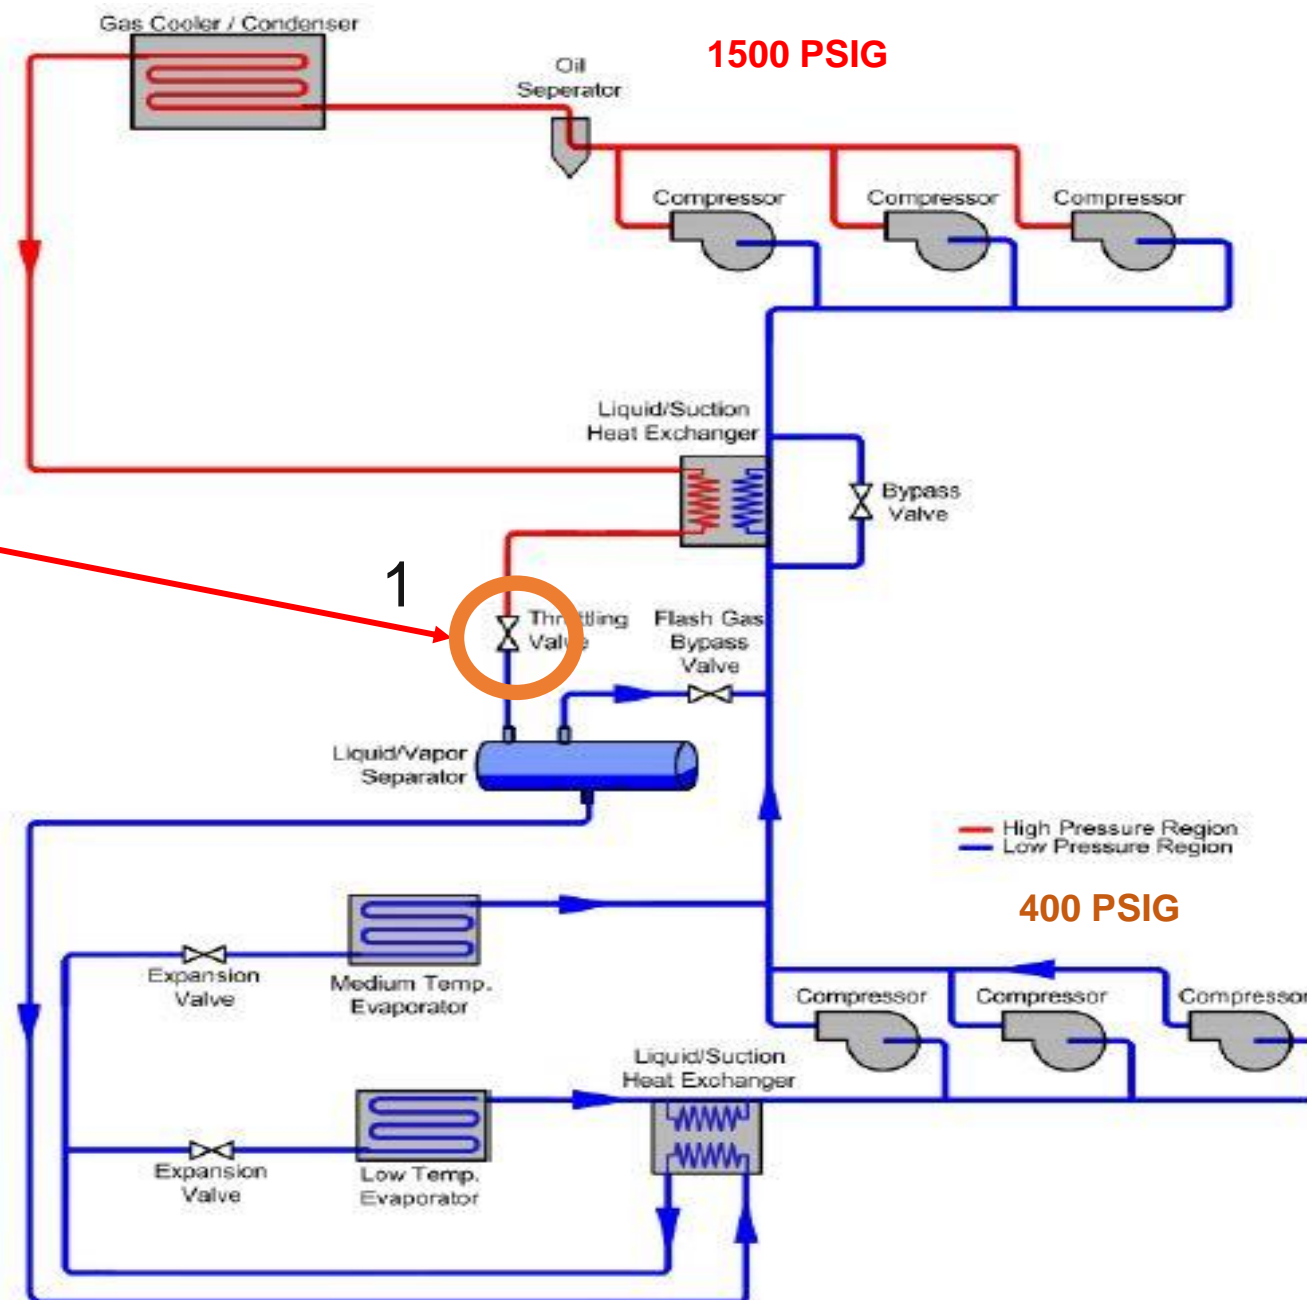


System Layout and Operation

- The flash gas bypass valve maintains the pressure in the flash tank, diverting excess vapor to the medium temp compressor suction.
- This valve also prevents liquid line pressure from going too high

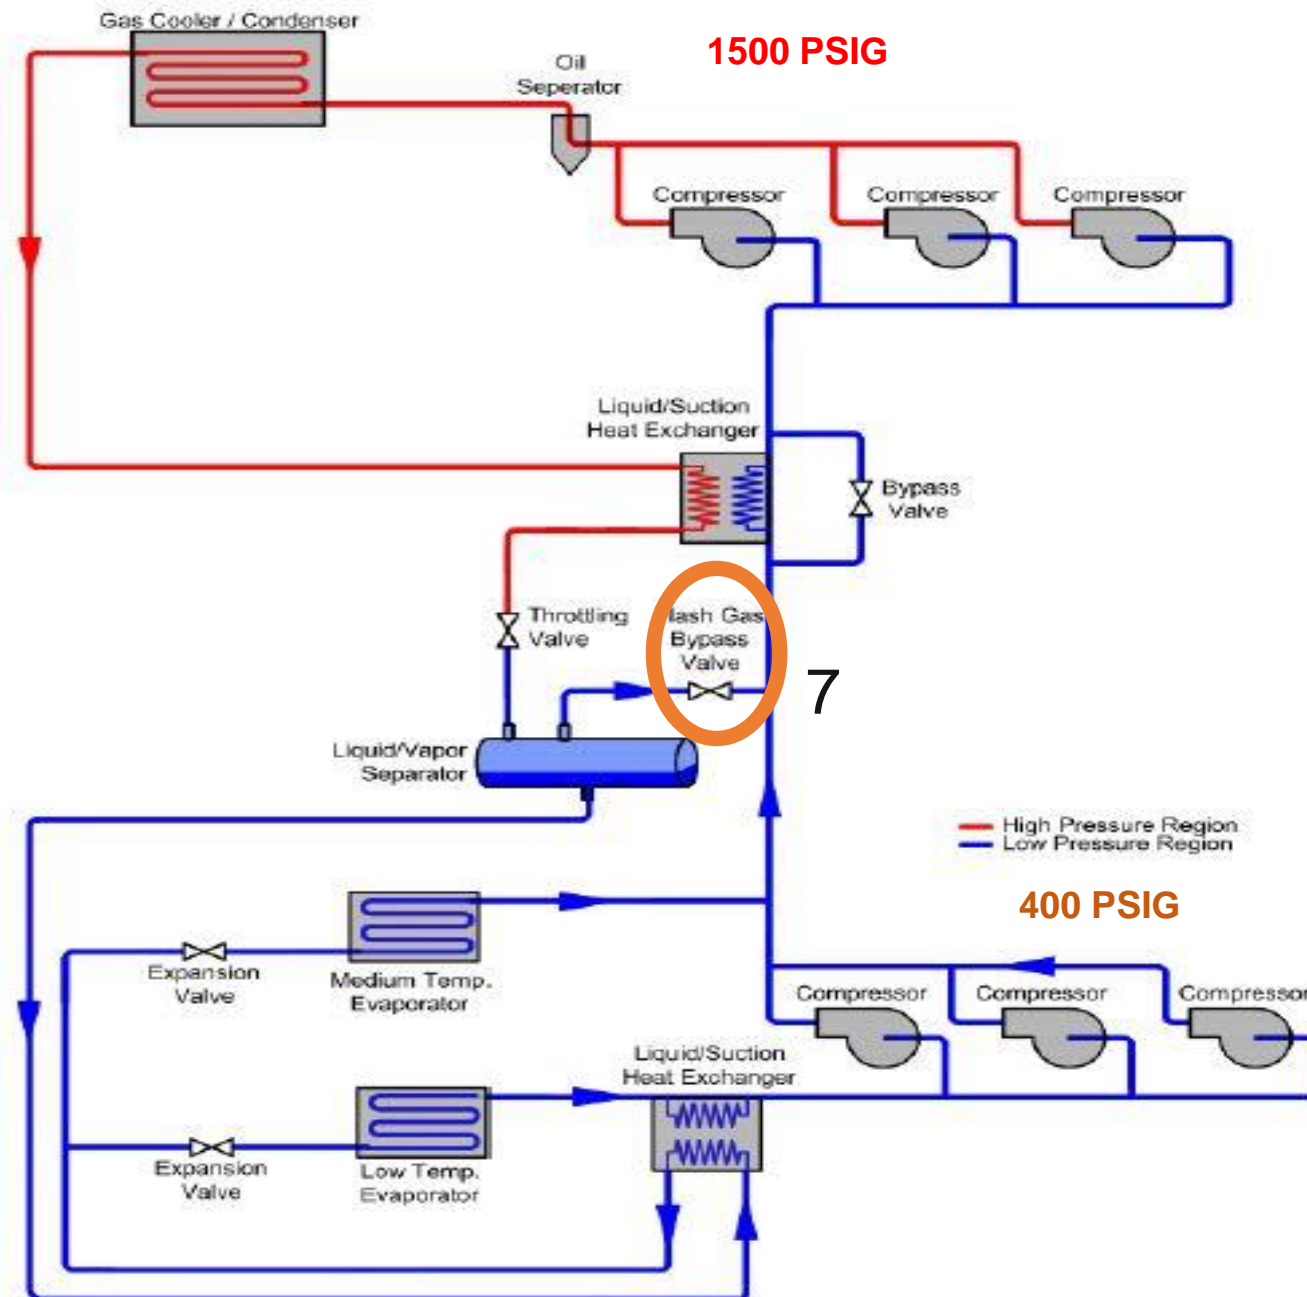


System Layout and Operation

- Medium compressor suction draws from 3 sources. There is a bit of a pressure drop from the low temp compressor discharge
- **SH Control is critical** due to suction gas coming from 3 sources
 - Too Low-- Poor lubrication and pulling oil
 - Too High- Oil degradation and compressor wear

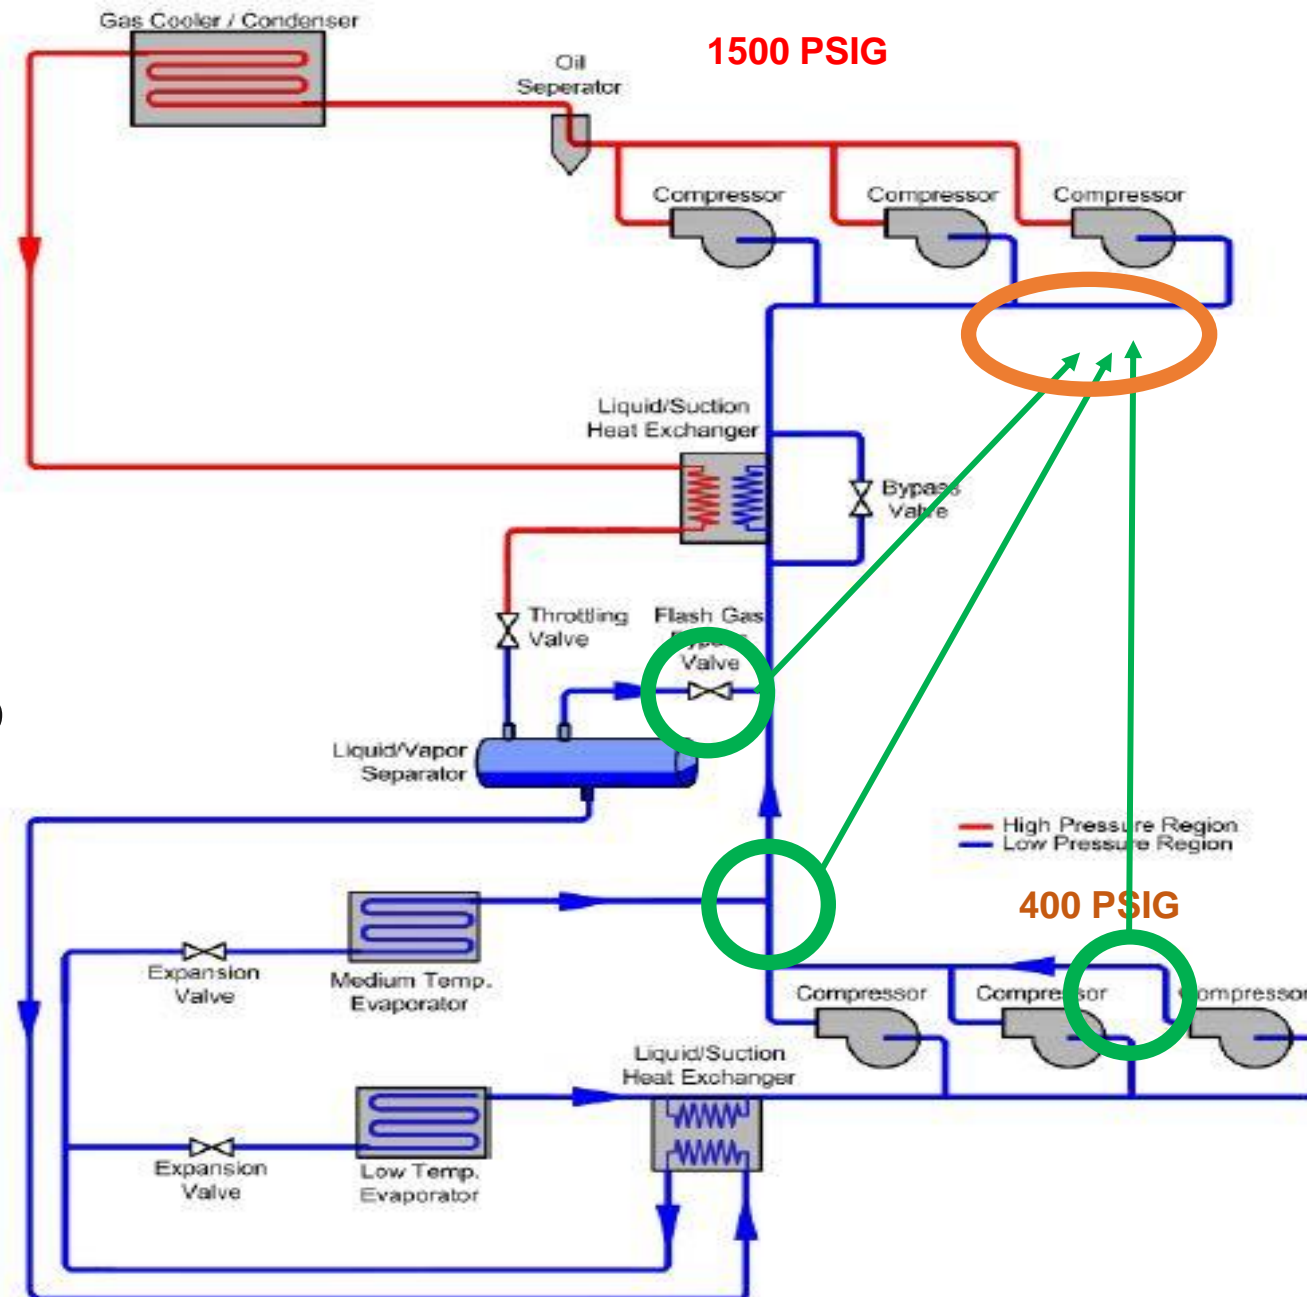

System Layout and Operation

- Gas Cooler removes heat from compressed gas
- If ambient is below critical point (88 °F), then the refrigerant will condense
- If above critical point, there will be no state change until the throttling valve
- AT and Gas Cooler outlet Temp sensors are **most important** for proper operation !!!!

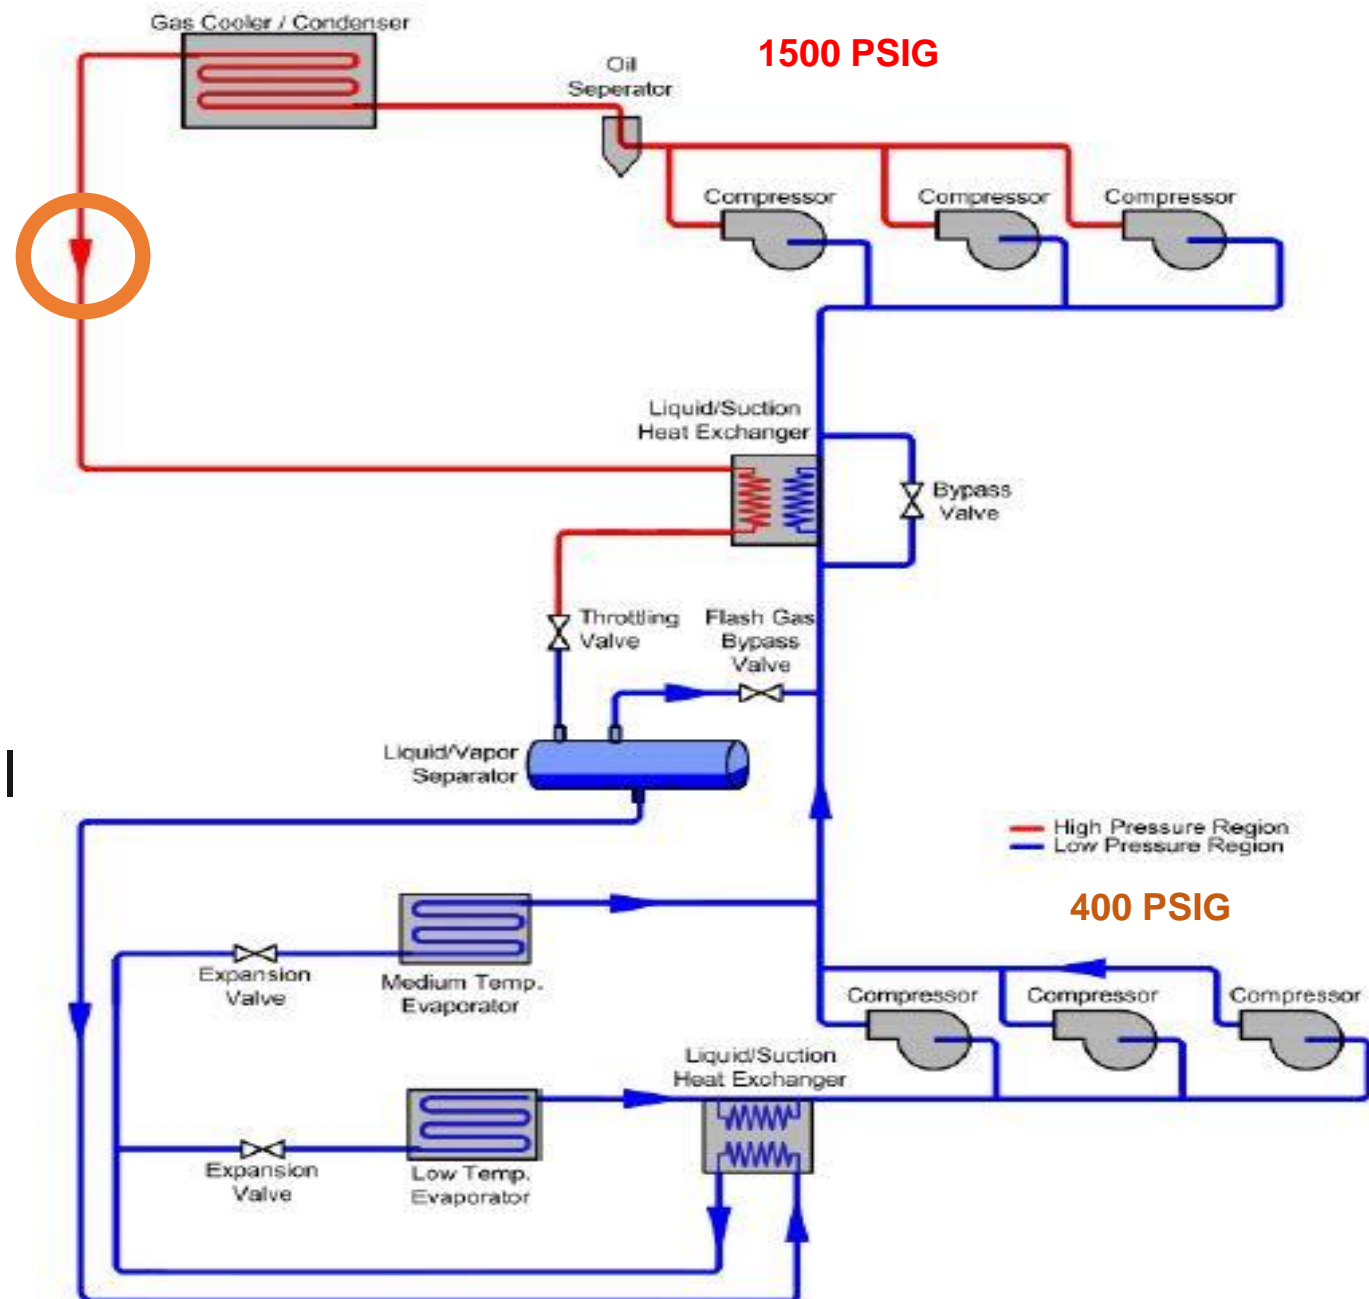




Flash Tank

- Provides a low velocity vessel to allow for liquid and vapor to separate after leaving the throttling valve
- Low-level switch is an optical sensor that will alarm below 20%
- Sight glasses only for level indication

HUSSMANN®

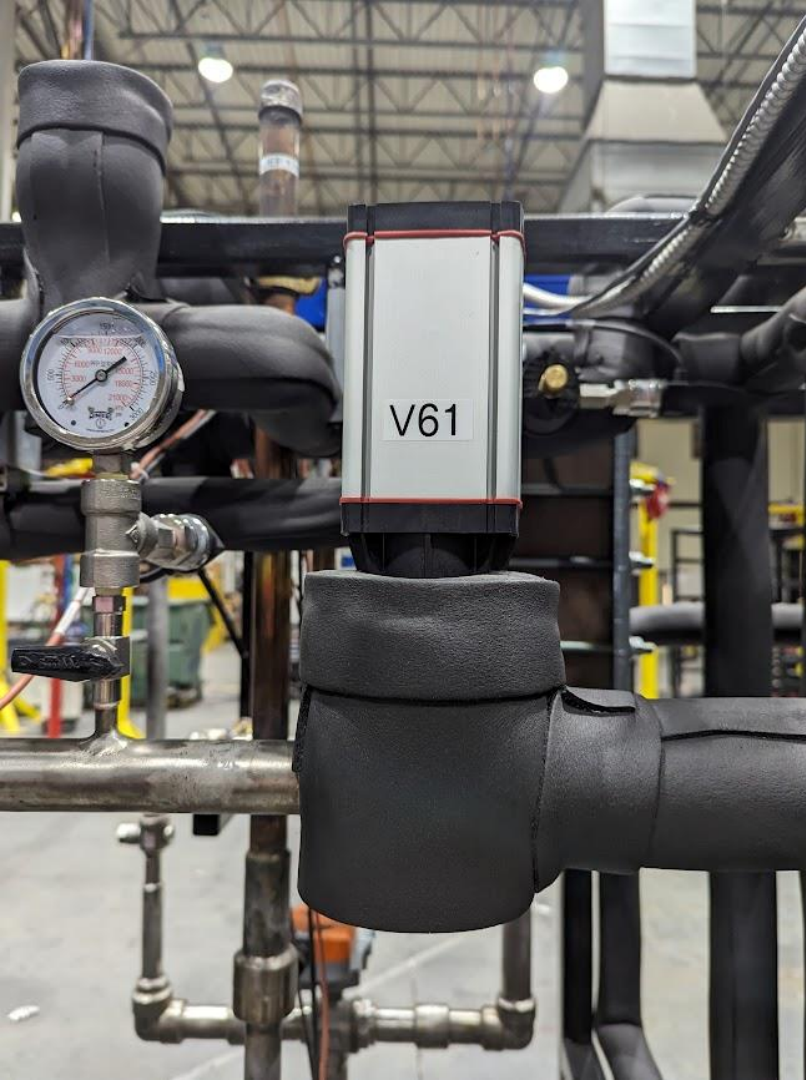

Throttling/High Pressure Valve

- Responds to Gas Cooler (outlet pressure and temperature)
- Transcritical operation: maintains pressure setpoint for best performance (COP curve varies)
- Subcritical operation: maintains a subcooled liquid in the gas cooler/condenser. Typically between 3-9 °F

HUSSMANN®




Flash Gas Bypass Valve

- Has a static receiver pressure setpoint
- Usually closed under low load/ambient conditions
- Should maintain a pressure of at least 75 PSI above suction pressure
- Flash Tank setpoint : 500-530 PSI
- Typical operating range : 480-550 PSI

HUSSMANN[®]


Hot Gas Dump Valve (SH)

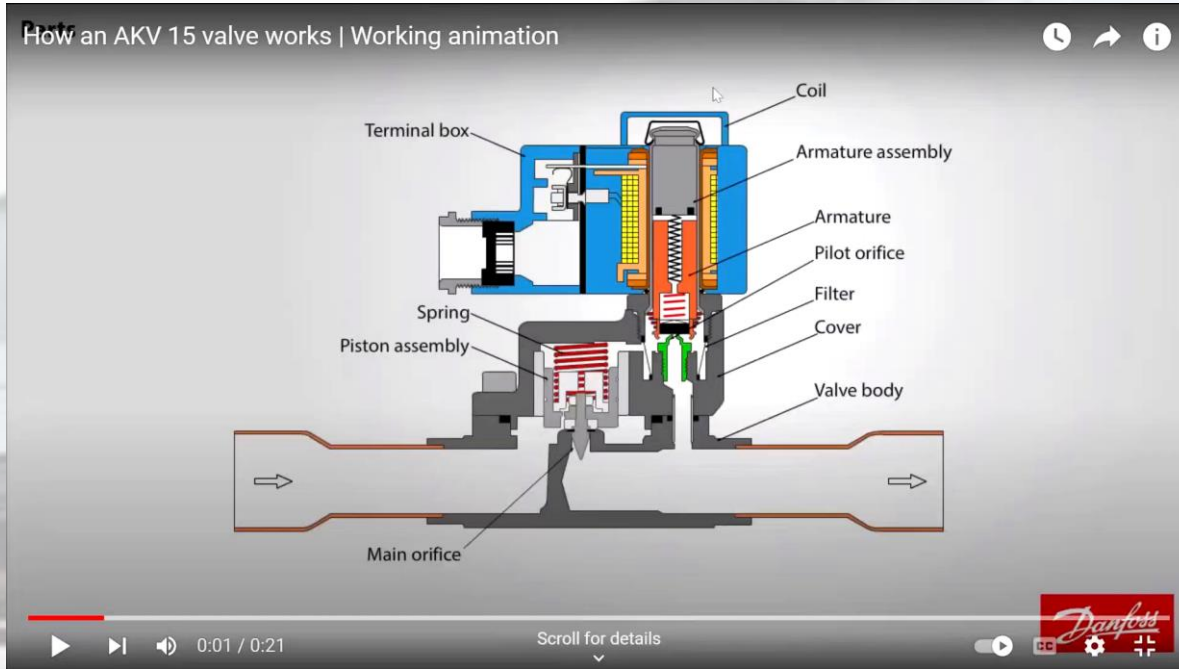

- Maintains MT suction superheat if low
- Pulse width modulation valve
- Setpoints:
 - MT HG Superheat setpoint = 20 °F
 - MT Suction Superheat Range = 20 – 40 °F
 - Superheat alarm setpoint = 10 °F


HUSSMANN®

Hot Gas Dump Valve (Flash Tank)

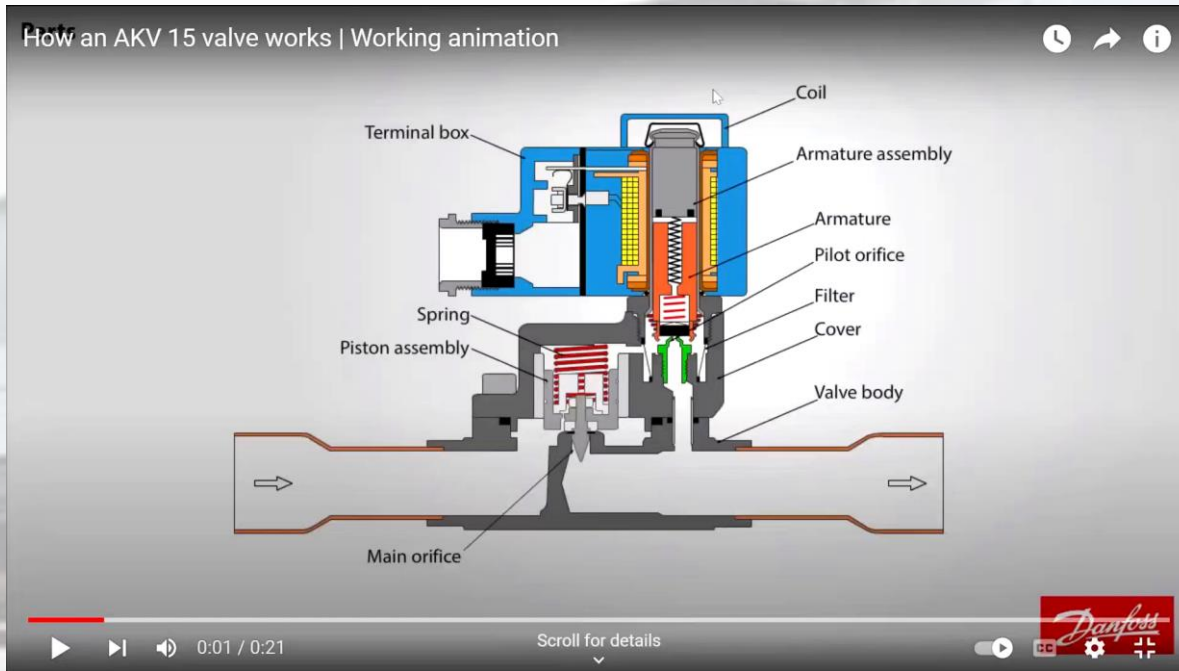

- Maintains Flash Tank pressure if low
- Pulse width modulation valve
- Setpoints:
 - Flash Tank HG setpoint = 460 PSIG
 - Flash Tank HG setpoint differential (typical) = 30 PSIG
 - Superheat alarm setpoint = 10 °F

HUSSMANN®

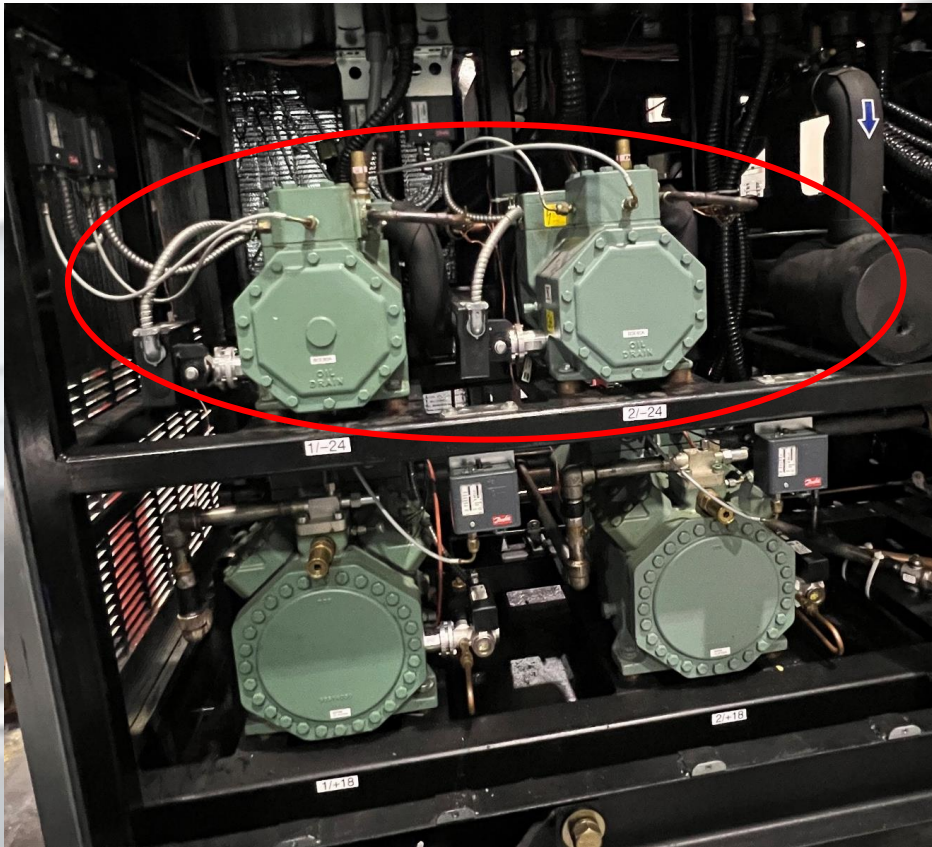

Compressor Staging

- Low Temp (-20 °F) and Medium Temp (20 °F)
- Typically maintains suction pressure corresponding to load and other conditions (about +/- 7 F)
- Setpoints:
 - LT Pumpdown = 162 PSIG
 - LT Suction Pressure Range = 162 – 208 PSIG
 - MT Pumpdown = 328 PSIG
 - MT Suction Pressure Range = 328 – 420 PSIG

HUSSMANN[®]

System Operation

- Low temperature compressors discharge into the medium temperature suction
- The extra heat of compression helps to manage Medium temp superheat (CO₂ systems have a higher SH, 36 - 52 °F)
- Medium temperature suction groups must have at least one compressor operating for the low temp compressors to run
- Each suction group has at least 1 VFD compressor

Parameter	Value	Unit	Notes
MT Low Suction	345	PSIG	Failure & Alarm
LT Low Suction	160	PSIG	Failure & Alarm
MT High Suction	475	PSIG	Alarm Only
LT High Suction	290	PSIG	Alarm Only
MT High Discharge	1522	PSIG	Failure & Alarm
LT High Discharge	490	PSIG	Failure & Alarm
MT Discharge (range)	600 – 1300	PSIG	Typical Range
LT VFD (range)	30 – 75	Hz	Typical Range
MT VFD (range)	25 – 70	Hz	Typical Range
Minimum off time	1	Minute	Typical Setting
Hourly cycles	6	Starts/Hr	Typical Setting

*** Typical Suction Group Parameters**



Compressor Control

- Each panel has controls that can electrically isolated and allow the other compressors to continue running:
 - Electrical control
 - Low and high-pressure switches
 - Oil pressure switch
 - Contactor coil
 - Overload contact (if used)
 - Crankcase heater

HUSSMANN®



Oil Management

- Two oil management areas :
 - Oil separator draining (rack controlled)
 - Compressor oil level (locally controlled)

HUSSMANN®

System Operation

- When the separator signals a high oil level, the rack controller will pulse the oil drain solenoid
 - Pulsing ensures that oil can be drained but not so much that hot gas will go to the flash tank
- Compressors have Emerson OMC oil level controls
 - When oil level drops, the OMC will energize the oil solenoid to fill the compressor
 - If unable to fill the compressor, the OMC will shut down the compressor.
 - The rack controller will generate an alarm

Parameter	Value	Unit	Notes
Oil Separator Drain Pulse Time	15	Seconds	
Oil Separator Drain Time	45	Seconds	
Oil Pressure (typical)	490 - 550	PSIG	Maintain 80 PSI above MT Suction
Oil Drain Cycles (typical)	20 - 40	Per/hr	

*** Typical Oil Management Parameters**



HUSSMANN®

Pressure Relief Valves

- Low Temperature Suction = 435 PSI
- Medium Temperature Suction = 650 PSI
- Flash Tank (Liquid Line) = 650 PSI
- Medium Temperature Discharge (high side) = 1740 PSI
- Due to the high pressures, all system relief valves are piped to the roof
- If they lift, evaluate before changing them!



Gas Cooler Fan Control

- Rack Controller monitors ambient, pad (adiabatic), and gas cooler outlet temperatures
- Controller calculates temperature difference and adjusts fan speed to maintain the ΔT (typically about 10 °F)

HUSSMANN®



Case Controllers

- Maintains the case temperature and superheat in the case by using the EEV
- Has a MOP (maximum operating pressure) that, if exceeded, will close the EEV




HUSSMANN®

System Operation

Parameter	Value	Unit	Notes
LT Case Controller MOP Setpoint	290	PSIG	Typical Setpoint
MT Case Controller MOP Setpoint	475	PSIG	Typical Setpoint
Case Controller Superheat	8 – 20	° F	Typical Operating Setpoint
Case Controller Superheat Band	8 – 15	° F	Typical Superheat Band Range
Case Controller Superheat Cut Out	4	° F	Typical Superheat Cut Out Setpoint

***Typical Case Controller Setpoints and Operating Parameters**

***Superheat will be different depending upon LT or MT Cases**

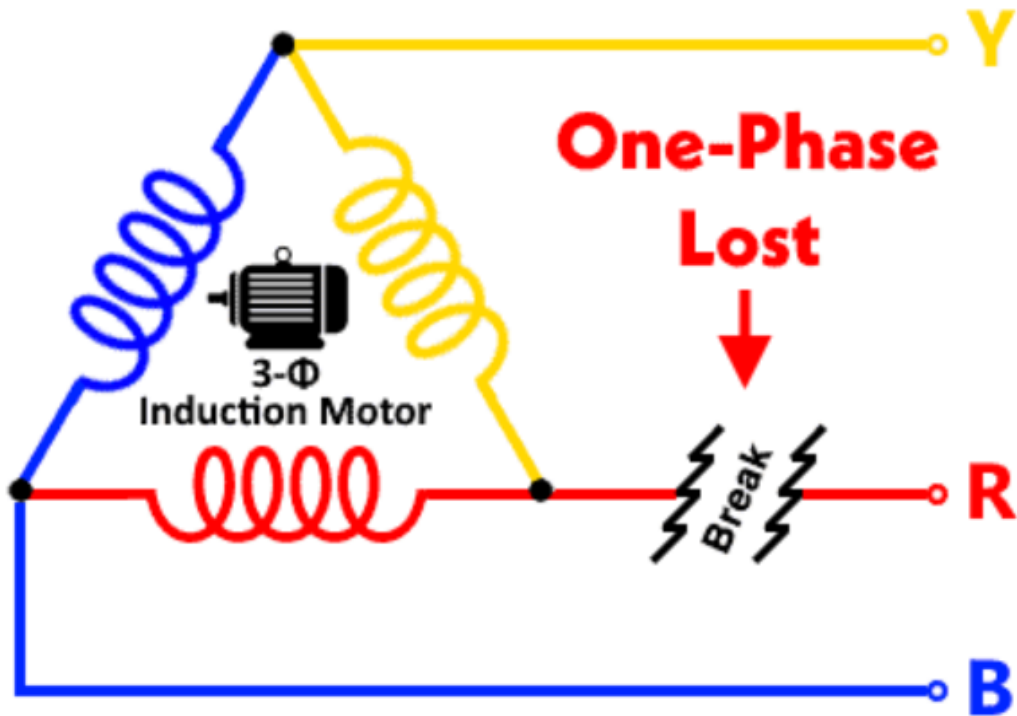

Phase Loss

- Phase loss can be caused by many issues
- The result is a shutdown until the emergency event is cleared
- To test during start-up, remove one leg, ensure that the unit shuts down
- This is instantaneous

Phase Loss

- A PLM is a digital input to rack controller that will close when voltage is outside normal range
- During the event all compressors will be kept off until the event clears
- To limit temperature and pressure increase of the refrigerant charge, the following conditions apply:
 - HPV & FGB will be shut
 - Defrosts disabled
 - Evaporator fans off
 - EEV's closed
- After the event clears, the rack will attempt a staged restart
 - Generally, 15-25% of circuits will come on per stage
 - Order of circuits brought on-line generally are from most critical to least



System Start-up

- Leak testing, Evacuation, Charging, Oil, etc.

HUSSMANN[®]



Leak Testing

- Both the rack and the system as a whole must be leak tested before evacuation

HUSSMANN®



GreenChill Best Practices Guideline
Ensuring Leak-Tight Installations of
Commercial Refrigeration Equipment

U.S. Environmental Protection Agency
Stratospheric Protection Division

HUSSMANN®

Leak Testing

- Charges should be held for 24 hours
- Due to the high operating pressure of CO₂ systems, standard pressure tests are:
 - LT Suction = 350 PSI
 - MT Suction/Liquid = 525 PSI
 - MT Discharge/Drain = 1400 PSI

<https://www.epa.gov/sites/default/files/documents/leakguidelines.pdf>

11/8/2023



System Evacuation

- Evacuation removes moisture, air, and other non-condensables from the system prior to charging with refrigerant

HUSSMANN[®]

System Evacuation

- Ensure that the system has passed its leak test
- Ensure pumps are in proper working order
- Ensure all valve packings are tightened
- Ensure liquid filters are installed before 3rd pull
- Crankcase heaters on
- All pump connections should be non-collapsible
- Ensure that all transducers are valved off as high vacuums can damage the sensors
- Charge oil during the 1st or 2nd evacuations
 - Compressors to half a sight glass
 - Reservoir to ½ full
- Ensure all caps on the rack are tightened (NO PLASTIC)

System Evacuation

- A maximum of 2 vacuum pumps are allowed, with a total capacity of **at least** 10 CFM (the stronger pump will always win)
 - A single pump of 25 CFM is preferred
- A Vacuum will be pulled 3 times:
 - 1st will be down to 1000 microns
 - 2nd will be down to 500 microns
 - 3rd and final vacuum will be held at 300 microns for 24 hours
- Pump oil should be changed after both the 1st and 2nd evacuations



Charging the System

- Due to its physical properties, CO₂ charging must be done in 2 stages: First with gas, and then with liquid


HUSSMANN[®]

Charging the System

- Prior to charging check the following:
 - Case sensor/transducer placement
 - Electrical checks (tight connections, cleanliness, vacuum any loose metal shavings)
 - Proper fan operation and rotation
 - Case controller settings/adjustment
 - Walk-in electricals (lights, fans, etc.)
 - Damper operation (if equipped)
 - Heat reclaim and other systems
 - Gas Cooler controls
 - Defrost schedule and timing
 - Ensure HPV and FGB are working (cycle them)

Charging the System

- CO₂ has a low tolerance for moisture and will form carbonic acid which can corrode piping and components
- Hussmann recommends a purity of “Bone Dry” (99.8%) or higher
- Most “Refrigerant Grade” CO₂ is 99.99% pure and has <10 PPM moisture content

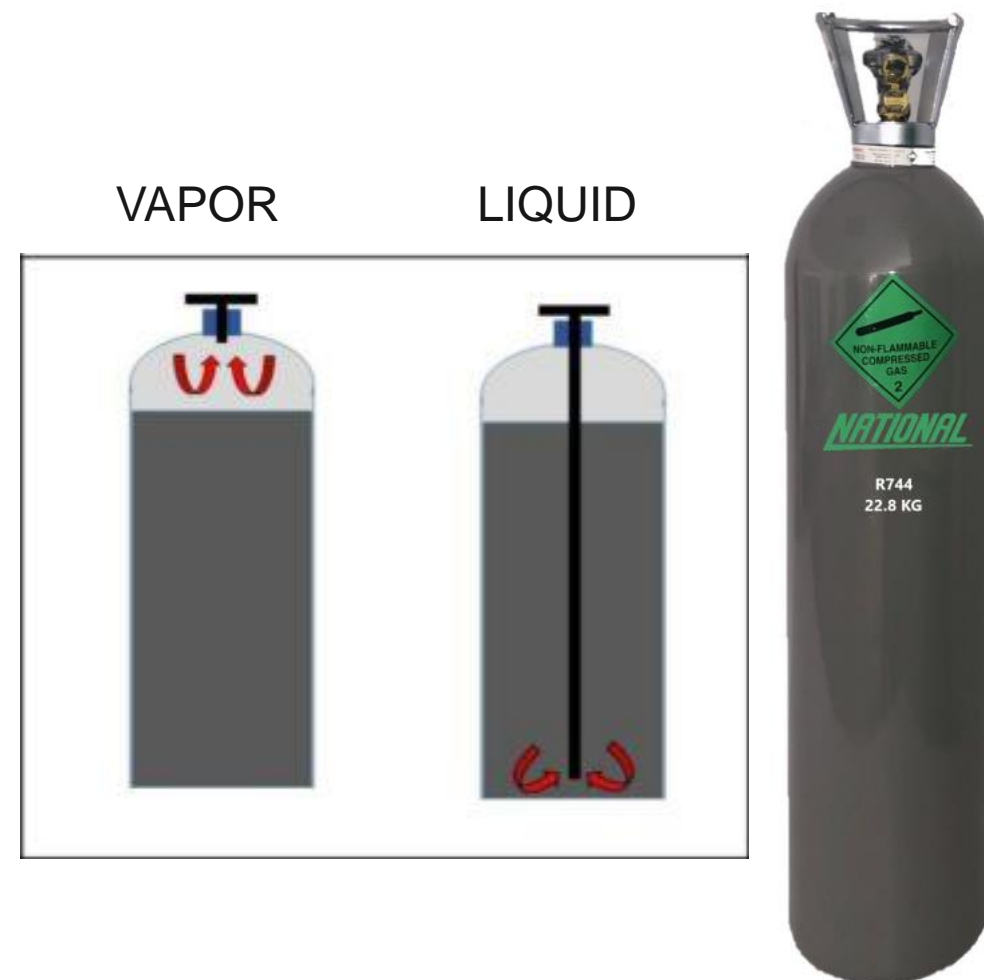

Charging the System

- CO₂ cannot exist as a liquid below 5.11 atmospheres (75 PSI)
- Charging the system with vapor up to 80 PSI prevents the formation of dry ice in the system
- Open compressors: backseat service valves
- Open oil supply line downstream of the oil separator
- Pressure transducers – open angle valves
- Leave open ball valves – to branches, gas cooler, heat reclaim, flash tank
- Set all mechanical pressure controls
- Charge system through an in-line filter/drier with vapor to 80-100 PSI
- Before adding liquid, check transducer function and case controller feedback (this will make start-up much smoother)

Charging the System

- After fixing any bad transducers or communication issues, proceed to liquid charging
- Pump down the system as you charge
- Close flash tank outlet and float 3 sight glasses
- Cease charging and open the flash tank outlet
- More charging may be needed as more loads come on-line

**Phase change using only pressure change



[**SOLID**
CO₂]



Start-up Sequence

HUSSMANN®

11/8/2023

Start-up Sequence

- ***At least 40% (this is the bare minimum and may not be enough!)*** of the load should be available prior to starting
- Perform a phase loss test to make sure all case EEV's shut down
- Leak detectors tested in walk-ins
- Start the medium temp compressor
- Continue to charge the system as needed
- All running compressors must be attended until system is fully charged with refrigerant and oil
- ****NOTE****: In new construction, set LT setpoints at 35 °F for 48 hours to pull moisture out of the boxes. Then drop to 10 °F for 24 hours. Then, set to recommended setting. (Customer's parameters will supersede this)

What to Monitor During Start-up

- Monitor for flood-back from controller parameters
- Watch oil levels in both the compressors and reservoir
- Make sure flash tank does not exceed 600 PSI
- Leave in Suction filters
- Ensure oil differential is set to at least 60-80 PSI (swedgelock only) above medium suction pressure (adjust if necessary). Hussmann has found that 80 PSI above medium suction is optimal

After Start-up


- Top off the oil charge
- Change the oil, filters, suction and liquid filters within 30 days (this should be done ASAP)
 - If customer has different requirements, they overrule this point
- Anytime after this point when the system is opened, drier cores must be replaced
- Leak test with a sniffer
- Verify defrost schedule is functioning properly
- Check case temperature and coils after defrost
- Fix any programming issues
- Verify sensors and transducers for calibration
- Record CO₂ level once system is stable
- Record and record amp draw on all 3 legs for each compressor
- Complete commissioning document

Other Checks on Day 1

- Review compressor cycle counts (no more than 6 per hour)
- Review HPV & FGB for excessive modulation
- Verify oil separator drain solenoid is cycling properly
- Check ΔP across the oil separator. Replace if greater than 10 PSI
- Clean oil supply line strainer
- Verify evaporators and compressor superheats

Checks on Day 3

- All Day 1 checks
- Replace liquid and suction filters (some operators wait for 7 days)
- Test oil for moisture and acidity

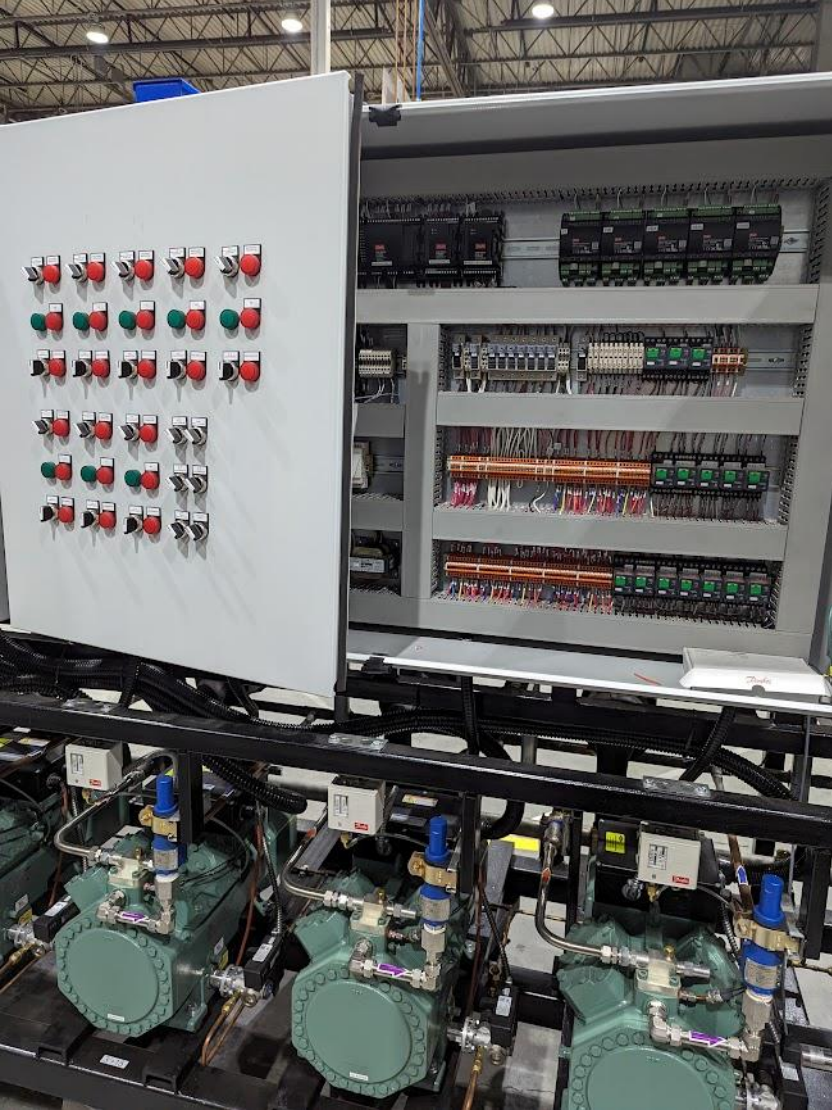

Maintenance Schedules

- These are Hussmann recommendations ONLY
- Customer prescribed maintenance schedules supersede the following pages

HUSSMANN[®]

Weekly Checks

- System Pressures
- Main Power Voltage
- Oil Levels
- Flash Tank CO₂ Level

Monthly Checks

- Oil Separator ΔP
- System Pressures
- Leak Testing
- Filters and Drier Cores (evacuate before re-pressurizing)
- Secondary Systems
- Insulation damage, Electrical Connections

Quarterly Checks

- Suction, Liquid, and Discharge Pressures and Temperatures
- Sub-cooling, Superheat, and Ambient Temperatures
- Safety Controls, Operating Controls, & Alarms
- Compressor Amperage

Annual Checks

- Clean Gas Cooler and Pads (Adiabatic)
- Change Filter Drier and Suction Cores
- Take Oil Sample, Change if Necessary

End of Deck

Share Your Feedback!



To receive an electronic training certificate:

1. Scan or visit nasrc.org/session-surveys
2. Provide your name and email at the end of the survey

Please Note: You will not receive a certificate unless you share your name on the survey form.

Hussmann CO2 Evacuation, Charging and

Start-Up

John Bento

Hussmann